

Test laboratory for the fire behavior of building materials, Dipl.-Ing. (FH) Andreas Hoch  
Testing, supervising and certifying body, authorized by the building supervision authority

# TEST REPORT

## PZ-Hoch-211192

for the proof of Fire behaviour according to DIN 4102, part 1

Translation of the German test report – no guarantee for translation of technical terms

<b>company</b>	<b>Heytex Bramsche GmbH</b> Heywinkelstr. 1 D-49565 Bramsche
<b>description of samples</b>	mesh fabric consisting of Polyester, coated on both sides with PVC colour: white
<b>name of the material</b>	„H5071 mesh matt FR B1/M1”
<b>sampling</b>	by the company itself
<b>content of request</b>	Proof of flammability to classify building materials to class B1 “schwerentflammbar” according to DIN 4102, part 1
<b>validity of test report</b>	30.09.2026
<b>result</b>	<b>The examined product meets the requirements of class B1 for “schwerentflammbare” (hardly flammable) building materials according to DIN 4102, part 1 (May 1998) , suspended freely or with distance of &gt;40 mm to same or other plain materials.</b> <b>The examined product shows burning droplets.</b>

This test report includes 4 pages and 6 enclosures.

Remark: If the above mentioned building material is not used as product according to MBO § 2, Abs. 9, Ziffer 1, there is no need for a general building supervisory test report.

This test report is not valid if the examined building material is used as product in the meaning of state building prescriptions (MBO § 17, Abs. 3).

This test report does not replace an eventually necessary proof of applicability concerning building supervisory or building laws in the meaning of state building prescriptions. This has to be verified by:

- “allgemeine bauaufsichtliche Zulassung” (general building inspectorate approval) or by
- „allgemeines bauaufsichtliches Prüfzeugnis“ (general building inspectorate certificate) or by
- “Zustimmung im Einzelfall” (exceptional approval)

This test report can underlie building supervisory procedures

- for regular building products for the prescribed proofs of conformity
- for non regular building products for the needed proofs of applicability.

This test report must not be published and copied without preceding agreement of the test laboratory and if agreed, only during validity and unchanged concerning appearance and contents.

**1. Description of test material in condition as delivered**

**PN 33896:** "H5071 mesh matt FR B1/M1" colour: white  
 -mesh fabric consisting of Polyester, coated on both sides with PVC-  
 side A: a little bit smoother  
characteristic values determined by the test laboratory:  
 area weight: about 363 g/m<sup>2</sup> thickness: about 0,43 mm

The testing laboratory is not provided with further details concerning composition of the tested building materials. Samples are deposited.

**2. Preparation of samples**

The samples were kept in climate chamber 23/50 until they reached constant weight.

**3. Arrangement of samples** mounting: freely suspended

#4857 flaming side A in warp direction  
 #4858 flaming side B in warp direction  
 #4859 flaming side A in weft direction  
 #4860 flaming side A in warp direction  
 #4861 flaming side A in warp direction

**4. Date of test** CW 37 in 2021

**5. Results** The test has been examined according to DIN 4102 (Mai 1998)

line no.	Measurement	Result with the tested specimen					Dim.
		#4857	#4858	#4859	#4860	#4861	
	Test number	#4857	#4858	#4859	#4860	#4861	
	flamed direction	warp	warp	weft	warp	warp	
	flamed side	A	B	A	A	A	
1	<u>Number of specimen arrangement</u> acc. to. DIN 4102/T15, schedule 1	1	1	1	1	1	
2	<u>Maximum flame height above bottom</u> edge of the specimen	40	50	50	40	60	cm
3	Time <sup>1)</sup>	0:06	0:10	0:34	0:05	1:10	min:s
4	<u>Burn through / melting</u> Time <sup>1)</sup>	0:04	0:04	0:04	0:04	0:05	min:s
5	<u>Observations on the back side of the specimen</u> Flames / Glowing Time <sup>1)</sup>	---	---	---	---	---	min:s
6	Change of color Time <sup>1)</sup>	./.	./.	./.	./.	./.	min:s
7	<u>Falling of burning droplets</u> Start <sup>1)</sup>	./.	./.	./.	./.	./.	min:s
8	Extent sporadic falling of burning droplets <sup>2)</sup>	---	---	---	---	---	
9	continuous falling of burning droplets <sup>2)</sup>	---	---	---	---	---	min:s
10	<u>Falling of burning droplets</u> Start <sup>1)</sup>	X 0:35/1:20	X 0:25/0:58	X 0:43	X 0:14	X 1:35/1:45	min:s
11	Extent sporadic falling of burning droplets <sup>2)</sup>	X	X	X	X	X	
12	continuous falling of burning droplets <sup>2)</sup>	---	---	---	---	---	

line no.	Measurement	Result with the tested specimen					Dim.
	Test number	#4857	#4858	#4859	#4860	#4861	
	flamed direction	warp	warp	weft	warp	warp	
	flamed side	A	B	A	A	A	
13	<u>Afterflame time at the bottom of the sieve (max.)</u>	0:06/0:27	0:02/0:07	0:09	0:03	0:28/0:24	min:s
14	<u>Impairment of the burner by dropping or falling material:</u> Time <sup>1)</sup>	./.	./.	./.	./.	./.	min:s
15	<u>Premature end of test</u> Final occurrence of burning at the specimen <sup>1)</sup>	./.	./.	./.	./.	./.	min:s
16	Time of eventually end of test <sup>1)</sup>	./.	./.	./.	./.	./.	min:s
17	<u>Afterflame after end of test</u> Time <sup>1)</sup>	./.	./.	./.	./.	./.	min:s
18	Number of specimen	./.	./.	./.	./.	./.	
19	Front side of specimen <sup>2)</sup>	./.	./.	./.	./.	./.	
20	Back side of specimen <sup>2)</sup>	./.	./.	./.	./.	./.	
21	flame length	./.	./.	./.	./.	./.	cm
22	<u>Afterglow after end of test</u> Time <sup>1)</sup>	./.	./.	./.	./.	./.	min:s
23	Number of specimen	./.	./.	./.	./.	./.	
24	<u>Place of appearance</u> Lower half of the specimen <sup>2)</sup>	./.	./.	./.	./.	./.	
25	Upper half of the specimen <sup>2)</sup>	./.	./.	./.	./.	./.	
26	Front side of specimen <sup>2)</sup>	./.	./.	./.	./.	./.	
27	Back side of specimen <sup>2)</sup>	./.	./.	./.	./.	./.	
28	<u>Density of smoke</u> ≤ 400 % * min	54	40	31	48	84	% * min
29	> 400 % * min <sup>4)</sup>	./.	./.	./.	./.	./.	% * min
30	Diagram: encl. no.	1	2	3	4	5	
31	<u>Residual lengths: individual value <sup>3)</sup></u> Specimen 1	51	54	60	67	53	cm
	Specimen 2	59	67	65	60	58	cm
	Specimen 3	59	55	62	53	56	cm
	Specimen 4	68	58	71	68	64	cm
32	<u>Average value, individual test <sup>3)</sup></u>	59	59	65	62	58	
33	<u>Photo of specimen in enclosure no.</u>	1	2	3	4	5	
34	<u>Flue gas temperature</u>	113	114	110	114	113	°C
35	Maximum of average value Time <sup>1)</sup>	09:15	09:48	09:27	09:36	10:00	min:s
36	Diagram: encl. no.	1	2	3	4	5	
37	Remarks: - none -						

<sup>1)</sup> indication of times: from the begin of testing procedure

<sup>2)</sup> checked off if applicable

<sup>3)</sup> indication of carrier/foam layer separated in case of fire-proofing agents

<sup>4)</sup> very strong development of smoke

## 6. Explanations concerning the testing procedure

There were no additional tests proceeded because of the residual length of  $\geq$  than 45 cm.

## 7. Summary of results and additional establishments to Fire Behaviour

line no.	measurement	Result with the tested specimen					Dim.
	test-no.	#4857	#4858	#4859	#4860	#4861	
	flamed direction flamed side	warp A	warp B	weft A	warp A	warp A	
1	residual length	59	59	65	62	58	cm
2	max. smoke temperature	113	114	110	114	113	°C
3	density of smoke - integral	54	40	31	48	84	%min
4	remarks: During the "Brandschacht"-tests #4857 and #4861 the material showed burning droplets.						

According to DIN 4102, part 1, "schwerentflammbare" (hardly flammable) building materials must meet the requirements of class B2.

Pursuant to additional tests in the ignitability apparatus this can be determined (appendix 6).

## 8. Special remarks

- This report is only valid for the material as described under paragraph 1. In combination with other materials or with additional coatings or grounds etc. the burning behaviour may differ.
- This test report is not valid for the exposure to outdoor climate conditions.
- This test report is not valid, as soon as the fabric is used as a building product in the sense of the "Landesbauordnungen" (state building requirements, MBO § 17, par. 3).
- This test report is no substitute for a General Building Inspectorate Certificate.
- This test report is granted without prejudice to the rights of third parties, in particular private proprietary rights.
- For legal interests only the German original version is relevant.
- In General Building Inspectorates procedures this test report can be based for
  - regular building materials for the required proof of accordance
  - for not regular building materials for the required proof of applicability

## 9. Validity

This test report is valid until the mentioned date on page 1. The test report becomes invalid in case the standards on which the tests are based are changed.

Fladungen, 20.09.2021

clerk in charge:



(Dipl.-Ing.(FH) Jürgen Hammer)



Head of the test laboratory:




(Dipl.-Ing.(FH) Andreas Hoch)

**„Brandschacht“-test #4857**



**measurement**

**#4857, PN33896: "H5071 mesh matt FR B1/M1" A + K**  
Max. flue temperature: 113°C, Smoke density integral: 54%/min  
Residual length: 59 cm

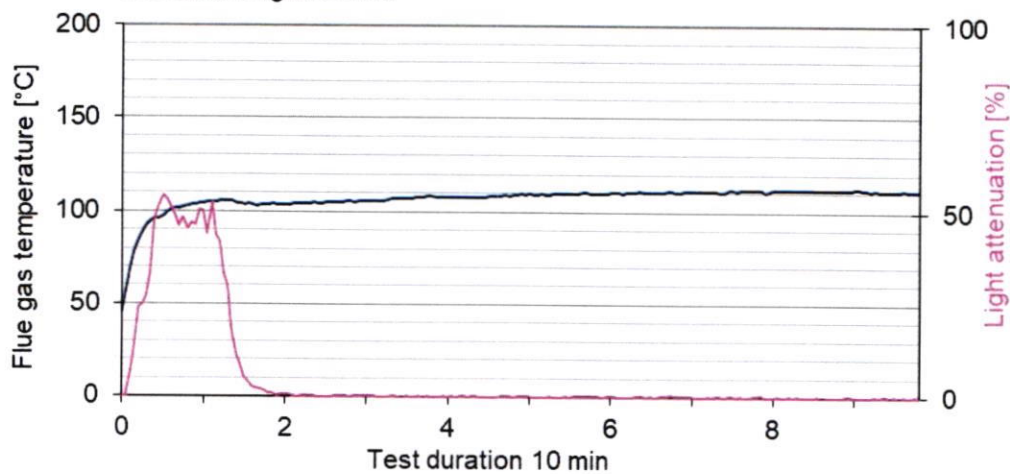


**„Brandschacht“-test #4858**




**measurement**

**#4858, PN33896: "H5071 mesh matt FR B1/M1", B + K**  
Max. flue temperature: 114°C, Smoke density integral: 40%min  
Residual length: 59 cm

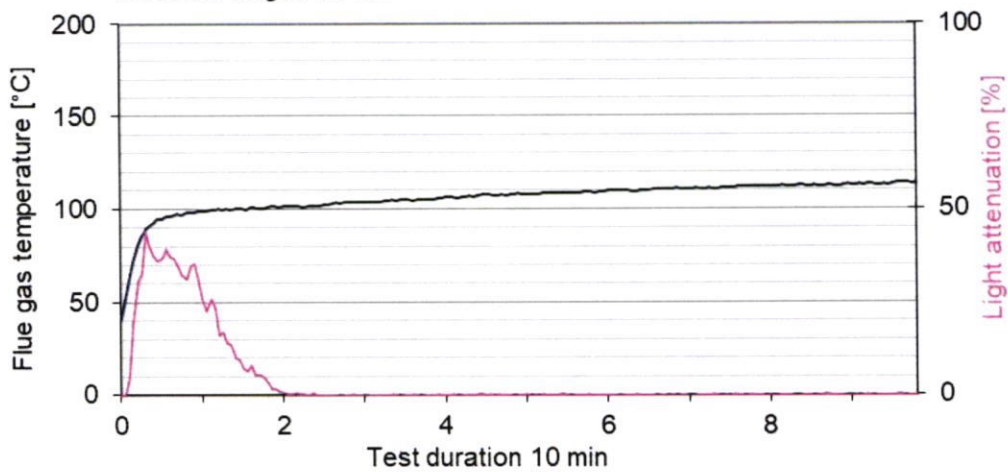


**„Brandschacht“-test #4859**

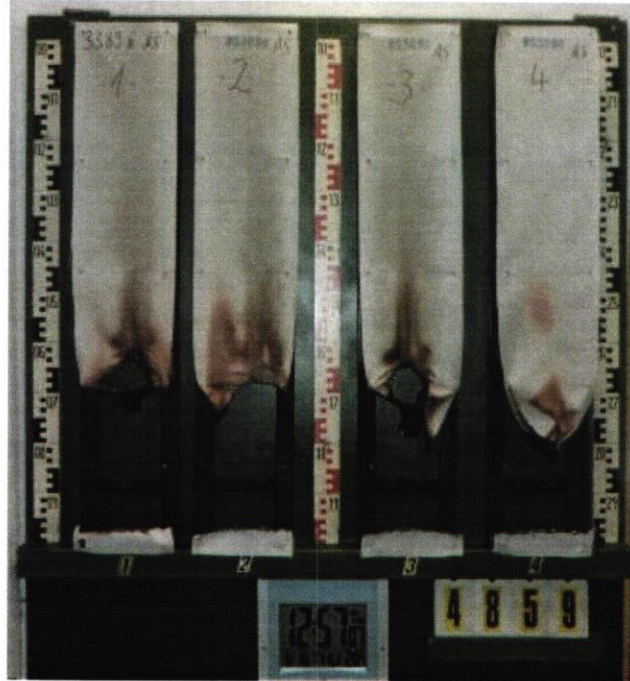


**measurement**

**#4859, PN33896: "H5071 mesh matt FR B1/M1", A + S**  
Max. flue temperature: 110°C, Smoke density integral: 31%min  
Residual length: 68 cm

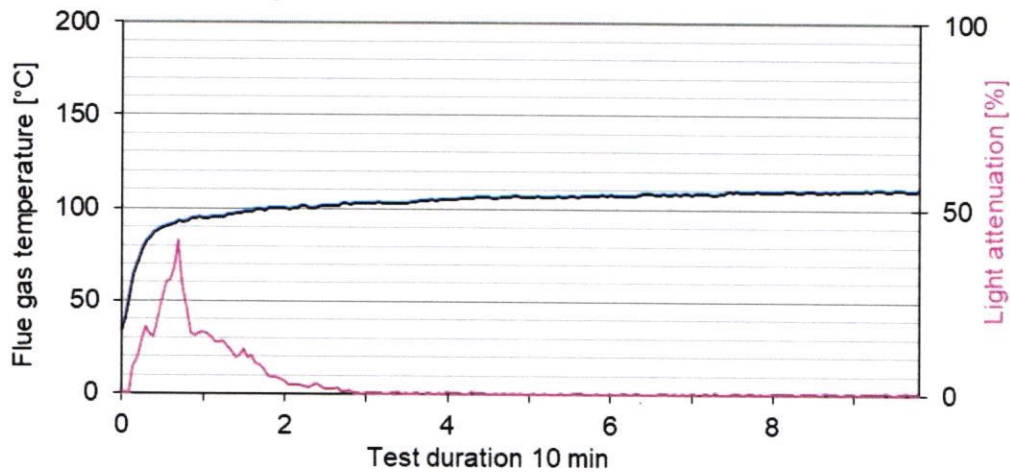


**„Brandschacht“-test #4860**

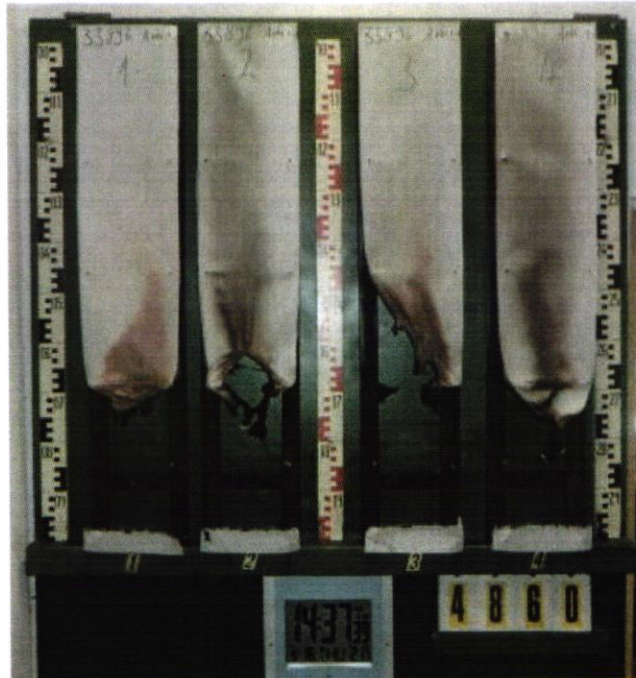


**measurement**

**#4860, PN33896: "H5071 mesh matt FR B1/M1", A + K**  
Max. flue temperature: 114°C, Smoke density integral: 48%min  
Residual length: 62 cm

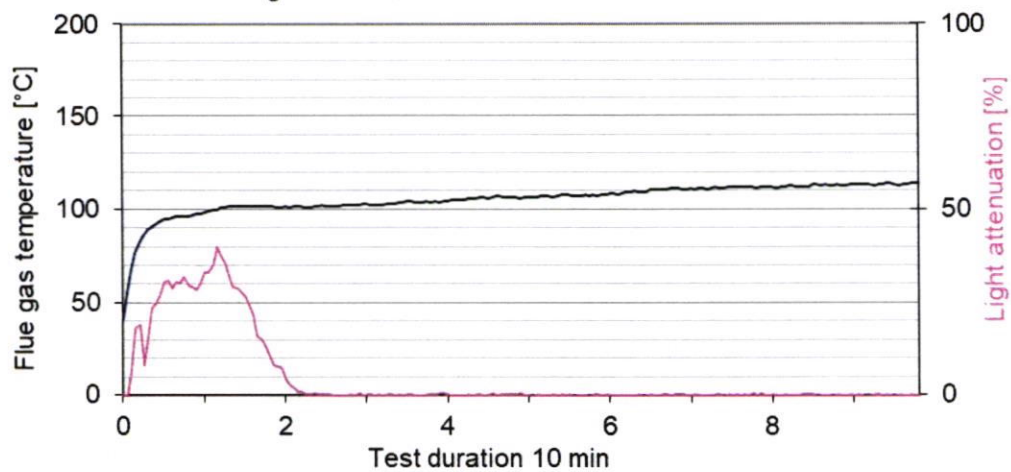




„Brandschacht“-test #4861

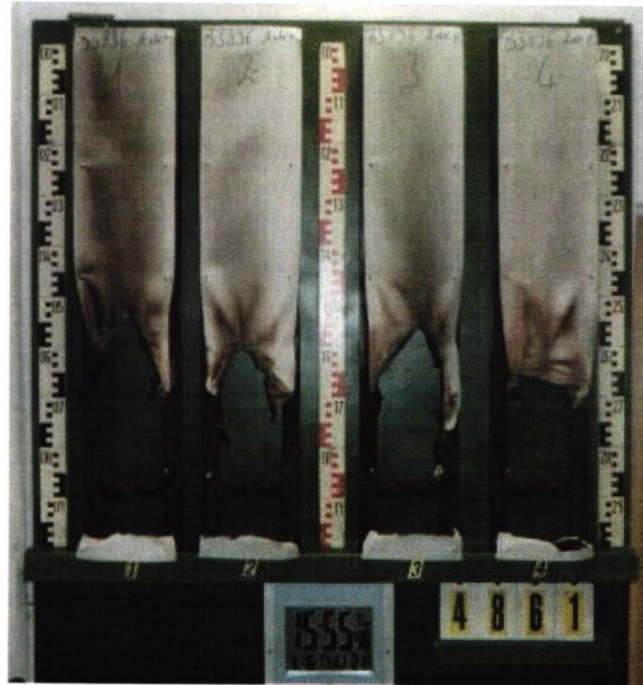

measurement

#4861, PN33896: "H5071 mesh matt FR B1/M1", A + K  
 Max. flue temperature: 113°C, Smoke density integral: 84%min  
 Residual length: 58 cm

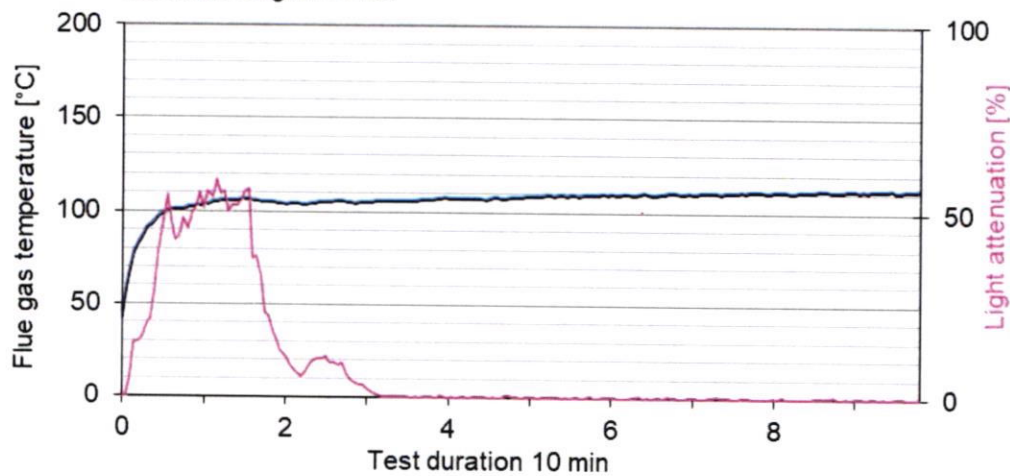

**Test for normal flammability  
classifying B2 according to DIN 4102**

1. Description of test material in condition as delivered look at page 2
2. Preparation of samples  
Out of the material there have been cut samples for the ignitability apparatus.  
The samples were kept in a climate 23/50 until they reached constant weight.
3. Arrangement of samples -freely suspended-  
Flaming in warp and weft direction / side A and side B
4. Date of test CW 36 in 2021
5. Results

PN 33896: flaming side B in weft direction	edge-test						surface-test						Dim
	1	2	3	4	5	6	1	2	3	4	5	6	
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	
ignition <sup>1)</sup>	1	1	1	1	1	--	3	--	--	--	--	--	s
reaching the mark of measurement <sup>1)2)</sup>	-/-	-/-	-/-	-/-	-/-	--	-/-	--	--	--	--	--	s
max. flame height	10	10	10	10	11	--	10	--	--	--	--	--	cm
time	10	10	10	10	12	--	10	--	--	--	--	--	
self cessation of the flames end of afterflame <sup>1)</sup>	10	12	10	12	14	--	15	--	--	--	--	--	s
end of glowing <sup>1)</sup>	-/-	-/-	-/-	--	--	--	-/-	-/-	-/-	--	--	--	s
flames were extinguished after <sup>1)</sup>	-/-	-/-	-/-	-/-	-/-	--	-/-	--	--	--	--	--	
smoke development (visual)	moderate						moderate						./.
dropping of burning material during 20 s <sup>1)</sup>	-/-	-/-	-/-	-/-	-/-	--	-/-	--	--	--	--	--	s
Appearance after test: burned out till max. height 10 cm x width 2 cm													

PN 33896: additional tests	edge-test						surface-test						Dim
	1	2	3	4	5	6	1	2	3	4	5	6	
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	
ignition <sup>1)</sup>	1	1	1	--	--	--	3	3	3	--	--	--	s
reaching the mark of measurement <sup>1)2)</sup>	-/-	-/-	-/-	--	--	--	-/-	-/-	-/-	--	--	--	s
max. flame height	10	10	10	--	--	--	8	8	8	--	--	--	cm
time	10	10	10	--	--	--	15	15	10	--	--	--	
self cessation of the flames end of afterflame <sup>1)</sup>	10	15	10	--	--	--	15	15	15	--	--	--	s
end of glowing <sup>1)</sup>	-/-	-/-	-/-	--	--	--	-/-	-/-	-/-	--	--	--	s
flames were extinguished after <sup>1)</sup>	-/-	-/-	-/-	--	--	--	-/-	-/-	-/-	--	--	--	s
smoke development (visual)	moderate						moderate						
dropping of burning material during 20 s <sup>1)</sup>	-/-	-/-	-/-	--	--	--	-/-	-/-	-/-	--	--	--	s
Appearance after test: burned out till max. height 10cm x width 2cm													

<sup>1)</sup> time mentioned from the beginning of the test <sup>2)</sup> during 20 Sec -/- no appearance -- no information

6. Remarks and explanations to the testing procedure - none -
7. Opinion concerning the dropping of burning material  
The test for normal flammability shows no burning dripping material.